

RECTANGULAR SMOKE CONTROL DAMPER



Characteristics:

A smoke control damper for fire ventilation and mixed ventilation systems, with an electric actuator without a return spring.



version: 25/02/26

Intended use

The KWP-P-E smoke control dampers are used in fire ventilation systems to prevent the spread of fire, heat and smoke.

he KWP-P-E smoke control dampers are certified by the Building Research Institute (ITB – Instytut Techniki Budowlanej). Certificate of Constancy of Performance No. **1488-CPR- 0437/W**. The set of dampers has been awarded the National Technical Assessment No. **ITB-KOT-2020/1398**.

During the normal operation of the system, the isolating baffle of the KWP-P-E dampers is in the open or closed position. In case of fire, the actuating system opens the dampers that operate the fire detection zone (dampers in other zones are closed).

The dampers are designed, manufactured and tested in accordance with the following standards: **PN-EN 12101-8** "Smoke and heat control systems – Part 8: Smoke control dampers" and **PN-EN 13501-4** "Fire classification of construction products and building elements – Part 4: Classification using data from fire resistance tests on components of smoke control systems."

The effectiveness of the dampers is confirmed by tests according to **PN-EN 1366-2** and **PN-EN 1366-10** "Fire resistance tests for service installations – Part 2: Fire dampers, Part 10: Smoke control dampers."

The KWP-P-E smoke control dampers are classified as **tightness class C** (Case leakage class of the damper installed in accordance with the Technical Documentation) devices on the basis of tests carried out according to **PN-EN 1751** "Ventilation for buildings. Air terminal devices. Aerodynamic testing of dampers and valves."

Classification

KWP-P-E dampers installed individually:

El 120 ($v_{ew-h_{ow-i \rightarrow o}}$) S1500C_{10 000}AAmulti

El 120 ($v_{ed-i \rightarrow o}$) S1000C_{10 000}AAmulti

KWP-P-E dampers installed in sets:

El 120 ($v_{edw-i \rightarrow o}$) S1000C_{10 000}AAmulti

It means that the automatically controlled damper installed in building partition or in a duct outside the building partition keeps integrity, insulating and smoke leakage properties for at least 120 minutes; the class above also means that the damper may

be operated remotely for at least 2 minutes from the moment of receiving the signal from the fire detector.

The KWP smoke control dampers can be installed in vertical and horizontal building partitions, with either a horizontal or a vertical rotation axis, with any actuator position, or in a duct outside a building partition, with a horizontal rotation axis, with any actuator position.

The dampers may be mounted individually or in sets (16 pcs max., up to 10 m²) in rigid walls or in a duct (shaft).

Description

The damper consists of two housings made of a galvanized metal sheet, separated with insulating separators made of a 40 mm thick fire-rated material. There is a baffle inside the damper. The movement of the baffle into the closed position by means of a set of tie rods is limited by a buffer. The axes of the baffle are embedded by slide bearings in the insulating separators. The baffle is closed by means of a set of tie rods.

The KWP-P-E smoke control dampers may optionally be equipped with two inspection openings, at the top and at the bottom, thus there is no necessity of installing inspection openings in the ducts close to the dampers in order to carry out periodic inspections and tests. There is also no need to determine the servicing side.

The permissible air velocity in a BxH connection duct for KWP-P-E dampers is 12 m/s.

Manufacturing versions

KWP-P-E – a smoke control damper (normally closed or open). The BEN, BEE or BE electric actuators of BELIMO form the drive system. Switching between open and closed position of the damper (and vice versa) takes place after the power supply has been applied to the proper actuator contacts. There are microswitches permanently installed in the actuator for indicating the open/closed position of the damper. The KWP-P-E dampers have no thermal switches, and the electric actuators used in the dampers have no return springs (voltage loss do not cause the movement of the damper isolating baffle).

The range of the dampers covers the following dimensions: a clear damper width from 200 to 1,500 mm (10 mm intervals) and a clear damper height from 200 to 1,500 mm (10 mm intervals), and is limited to the gross surface area of 1.5 m². Above this size the dampers are manufactured as sets (batteries). The damper

batteries are delivered disassembled into single dampers and prepared for assembly on site.

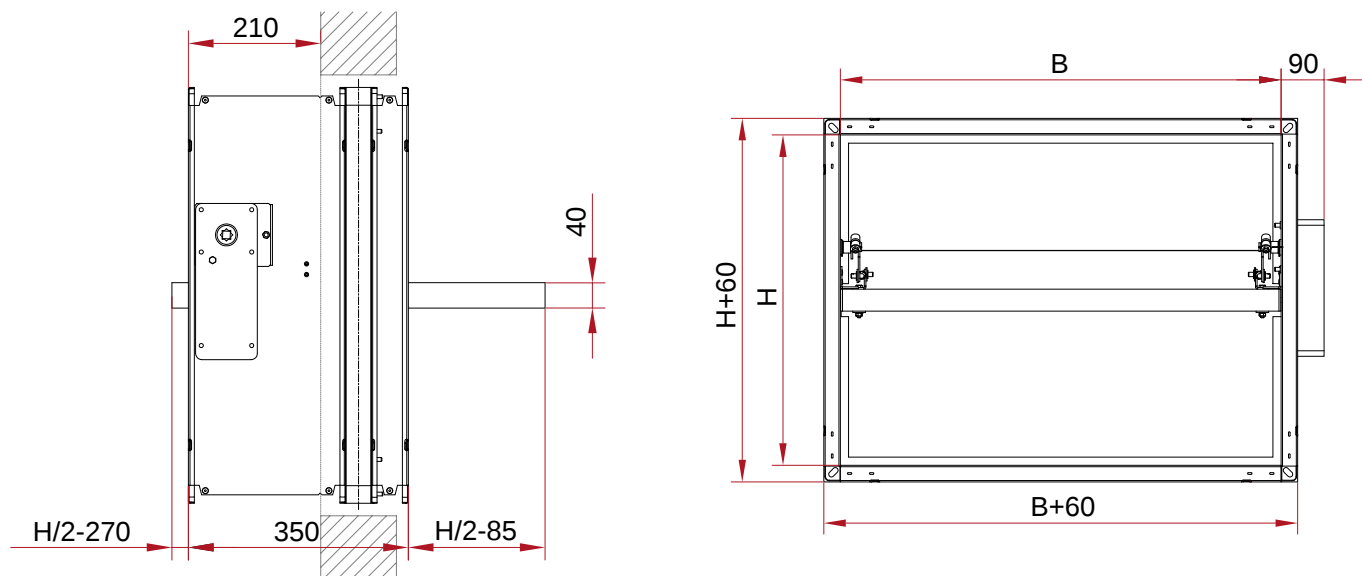


Figure 1. Figure 1. KWP-P-E damper (with an electric actuator without a return spring).



When mounting the damper with an actuator on the opposite side of the body, rotate the damper 180 degrees – cables will go up from the actuator.

Technical data

Table 1. The net surface area and the range of actuators used for the KWP-P damper.

KWP-P	Width B [mm]																											
	200	250	300	350	400	450	500	550	600	650	700	750	800	850	900	950	1000	1050	1100	1150	1200	1250	1300	1350	1400	1450	1500	
Height H [mm]	200	0,027	0,035	0,042	0,049	0,056	0,064	0,071	0,078	0,085	0,093	0,100	0,107	0,114	0,122	0,129	0,136	0,143	0,151	0,158	0,165	0,172	0,180	0,187	0,194	0,201	0,209	0,216
	250	0,037	0,046	0,056	0,066	0,076	0,085	0,095	0,105	0,115	0,124	0,134	0,144	0,154	0,163	0,173	0,183	0,193	0,202	0,212	0,222	0,232	0,241	0,251	0,261	0,271	0,280	0,290
	300	0,046	0,058	0,070	0,083	0,095	0,107	0,119	0,132	0,144	0,156	0,168	0,181	0,193	0,205	0,217	0,230	0,242	0,254	0,266	0,279	0,291	0,303	0,315	0,328	0,340	0,352	0,364
	350	0,055	0,070	0,085	0,099	0,114	0,129	0,144	0,158	0,173	0,188	0,203	0,217	0,232	0,247	0,262	0,276	0,291	0,306	0,321	0,335	0,350	0,365	0,380	0,394	0,409	0,424	0,439
	400	0,064	0,082	0,099	0,116	0,133	0,151	0,168	0,185	0,202	0,220	0,237	0,254	0,271	0,289	0,306	0,323	0,340	0,358	0,375	0,392	0,409	0,427	0,444	0,461	0,478	0,496	0,513
	450	0,074	0,093	0,113	0,133	0,153	0,172	0,192	0,212	0,232	0,251	0,271	0,291	0,311	0,330	0,350	0,370	0,390	0,409	0,429	0,449	0,469	0,488	0,508	0,528	0,548	0,567	0,587
	500	0,083	0,105	0,127	0,150	0,172	0,194	0,216	0,239	0,261	0,283	0,305	0,328	0,350	0,372	0,394	0,417	0,439	0,461	0,483	0,506	0,528	0,550	0,572	0,595	0,617	0,639	0,661
	550	0,092	0,117	0,142	0,166	0,191	0,216	0,241	0,265	0,290	0,315	0,340	0,364	0,389	0,414	0,439	0,463	0,488	0,513	0,538	0,562	0,587	0,612	0,637	0,661	0,686	0,711	0,736
	600	0,101	0,129	0,156	0,183	0,210	0,238	0,265	0,292	0,319	0,347	0,374	0,401	0,428	0,456	0,483	0,510	0,537	0,565	0,592	0,619	0,646	0,674	0,701	0,728	0,755	0,783	0,810
	650	-	0,140	0,170	0,200	0,230	0,259	0,289	0,319	0,349	0,378	0,408	0,438	0,468	0,497	0,527	0,557	0,587	0,616	0,646	0,676	0,706	0,735	0,765	0,795	0,825	0,854	0,884
	700	-	0,152	0,184	0,217	0,249	0,281	0,313	0,346	0,378	0,410	0,442	0,475	0,507	0,539	0,571	0,604	0,636	0,668	0,700	0,733	0,765	0,797	0,829	0,862	0,894	0,926	0,958
	750	-	0,164	0,199	0,233	0,268	0,303	0,338	0,372	0,407	0,442	0,477	0,511	0,546	0,581	0,616	0,650	0,685	0,720	0,755	0,789	0,824	0,859	0,894	0,928	0,963	0,998	1,033
	800	-	-	0,213	0,250	0,287	0,325	0,362	0,399	0,436	0,474	0,511	0,548	0,585	0,623	0,660	0,697	0,734	0,772	0,809	0,846	0,883	0,921	0,958	0,995	1,032	1,070	1,107
	850	-	-	0,227	0,267	0,307	0,346	0,386	0,426	0,466	0,505	0,545	0,585	0,625	0,664	0,704	0,744	0,784	0,823	0,863	0,903	0,943	0,982	1,022	1,062	1,102	1,141	1,181
	900	-	-	0,241	0,284	0,326	0,368	0,410	0,453	0,495	0,537	0,579	0,622	0,664	0,706	0,748	0,791	0,833	0,875	0,917	0,960	1,002	1,044	1,086	1,129	1,171	1,213	1,255
	950	-	-	-	0,300	0,345	0,390	0,435	0,479	0,524	0,569	0,614	0,658	0,703	0,748	0,793	0,837	0,882	0,927	0,972	1,016	1,061	1,106	1,151	1,195	1,240	1,285	1,330
	1000	-	-	-	0,317	0,364	0,412	0,459	0,506	0,553	0,601	0,648	0,695	0,742	0,790	0,837	0,884	0,931	0,979	1,026	1,073	1,120	1,168	1,215	1,262	1,309	1,357	1,404
	1050	-	-	-	0,334	0,384	0,433	0,483	0,533	0,583	0,632	0,682	0,732	0,782	0,831	0,881	0,931	0,981	1,030	1,080	1,130	1,180	1,229	1,279	1,329	1,379	-	-
	1100	-	-	-	-	0,403	0,455	0,507	0,560	0,612	0,664	0,716	0,769	0,821	0,873	0,925	0,978	1,030	1,082	1,134	1,187	1,239	1,291	1,343	1,396	-	-	-
	1150	-	-	-	-	0,422	0,477	0,532	0,586	0,641	0,696	0,751	0,805	0,860	0,915	0,970	1,024	1,079	1,134	1,189	1,243	1,298	1,353	1,408	-	-	-	-
1200	-	-	-	-	0,441	0,499	0,556	0,613	0,670	0,728	0,785	0,842	0,899	0,957	1,014	1,071	1,128	1,186	1,243	1,300	1,357	1,415	-	-	-	-	-	
1250	-	-	-	-	-	0,520	0,580	0,640	0,700	0,759	0,819	0,879	0,939	0,998	1,058	1,118	1,178	1,237	1,297	1,357	1,417	-	-	-	-	-	-	
1300	-	-	-	-	-	0,542	0,604	0,667	0,729	0,791	0,853	0,916	0,978	1,040	1,102	1,165	1,227	1,289	1,351	1,414	-	-	-	-	-	-	-	
1350	-	-	-	-	-	0,564	0,629	0,693	0,758	0,823	0,888	0,952	1,017	1,082	1,147	1,211	1,276	1,341	1,406	-	-	-	-	-	-	-	-	
1400	-	-	-	-	-	-	0,653	0,720	0,787	0,855	0,922	0,989	1,056	1,124	1,191	1,258	1,325	1,393	-	-	-	-	-	-	-	-	-	
1450	-	-	-	-	-	-	0,677	0,747	0,817	0,886	0,956	1,026	1,096	1,165	1,235	1,305	1,375	-	-	-	-	-	-	-	-	-	-	
1500	-	-	-	-	-	-	0,701	0,774	0,846	0,918	0,990	1,063	1,135	1,207	1,279	1,352	1,424	-	-	-	-	-	-	-	-	-	-	

ATTENTION - the maximum gross area (BxH) is 1.5 m².

0.123 - actuator **BEN** (BxH ≤ 1,21 m² and H ≤ 1100 mm)

0.123 - actuator **BEE** ((B ≤ 1050 and 1100 < H ≤ 1200) or (1,21 m² < BxH ≤ 1,30 m² and H ≤ 1200 mm))

0.123 - actuator **BE** (BxH > 1,30 m² or H > 1200 mm)



Max BxH gross surface area is 1.5 m².

Table 2. Pressure drop on KWP-P damper, Δp [Pa].

KWP-P	v [m/s]	Width B [mm]														
		200	300	400	500	600	700	800	900	1000	1100	1200	1300	1400	1500	
Height H [mm]	200	4	12	12	10	10	10	10	8	8	8	7	7	7	6	6
		6	25	25	22	22	22	22	20	20	20	19	18	18	17	17
		8	45	46	40	40	40	40	38	38	36	36	35	34	33	33
		10	68	68	60	60	60	60	56	56	56	52	52	52	50	48
	300	4	8	8	7	7	7	7	7	6	6	5	5	4	4	4
		6	18	18	15	15	15	15	15	13	13	11	11	10	8	8
		8	32	32	27	27	27	27	27	24	24	22	22	20	20	18
		10	48	48	41	41	41	41	41	35	35	30	30	26	26	24
	400	4	7	7	6	6	6	5	5	5	5	5	5	5	5	4
		6	15	15	13	13	13	11	11	11	11	11	11	11	11	9
		8	27	27	24	24	24	20	20	20	20	20	20	20	20	17
		10	41	41	35	35	35	30	30	30	30	30	30	30	30	26
	500	4	7	7	6	5	5	5	5	4	4	4	4	4	4	4
		6	14	13	13	11	11	11	11	9	9	9	9	9	9	9
		8	25	24	24	20	20	20	20	16	16	16	16	18	18	18
		10	38	35	35	30	30	30	30	24	24	24	24	24	24	24
	600	4	7	6	5	5	4	4	4	4	3	3	3	3	4	4
		6	14	13	11	11	9	9	9	9	7	7	7	7	9	9
		8	26	24	20	20	16	16	16	16	12	12	12	14	18	18
		10	40	35	30	30	24	24	24	24	18	18	18	18	24	24
	700	4	-	5	5	4	4	4	3	3	3	3	3	3	3	3
		6	-	11	11	9	9	9	7	7	7	7	7	7	7	7
		8	-	20	20	16	16	16	12	12	12	12	12	14	14	14
		10	-	30	30	24	24	24	18	18	18	18	18	18	18	18
	800	4	-	5	5	4	4	4	3	3	3	3	3	2	3	3
		6	-	11	11	9	9	9	7	7	7	7	7	5	7	7
		8	-	20	20	16	16	16	12	12	12	12	12	10	14	14
		10	-	30	30	24	24	24	18	18	18	18	18	12	18	18
	900	4	-	5	4	4	4	3	3	3	3	3	2	2	2	2
		6	-	11	9	9	9	7	7	7	7	7	5	5	5	5
		8	-	20	16	16	16	12	12	12	12	12	8	10	10	10
		10	-	30	24	24	24	18	18	18	18	18	12	12	12	12
	1000	4	-	-	4	4	3	3	3	3	3	2	2	2	2	2
		6	-	-	9	9	7	7	7	7	7	5	5	5	5	5
		8	-	-	16	16	12	12	12	12	12	8	8	10	10	10
		10	-	-	24	24	18	18	18	18	18	12	12	12	12	12
	1100	4	-	-	4	3	3	3	3	3	3	2	2	2	-	-
		6	-	-	9	7	7	7	7	7	7	5	5	5	-	-
		8	-	-	16	12	12	12	12	12	12	8	8	10	-	-
		10	-	-	24	18	18	18	18	18	18	12	12	12	-	-
1200	4	-	-	3	3	3	3	3	3	2	2	2	-	-	-	
	6	-	-	7	7	7	7	7	7	5	5	5	-	-	-	
	8	-	-	12	12	12	12	12	12	8	8	8	-	-	-	
	10	-	-	18	18	18	18	18	18	12	12	12	-	-	-	

	1300	4	-	-	-	3	3	3	2	2	2	2	-	-	-	-
		6	-	-	-	7	7	7	5	5	5	5	-	-	-	-
		8	-	-	-	12	12	12	8	8	8	8	-	-	-	-
		10	-	-	-	18	18	18	12	12	12	12	-	-	-	-
	1400	4	-	-	-	3	2	2	2	2	2	-	-	-	-	-
		6	-	-	-	7	5	5	5	5	5	-	-	-	-	-
		8	-	-	-	12	8	8	8	8	8	-	-	-	-	-
		10	-	-	-	18	12	12	12	12	12	-	-	-	-	-
	1500	4	-	-	-	2	2	2	2	2	2	-	-	-	-	-
		6	-	-	-	5	5	5	5	5	5	-	-	-	-	-
		8	-	-	-	8	8	8	8	8	8	-	-	-	-	-
		10	-	-	-	12	12	12	12	12	12	-	-	-	-	-

v [m/s] - air flow velocity in the BxH connection duct

Table 3. Sound power level emitted by the KWP-P damper to the duct, L_{WA} [dB(A)].

KWP-P	v [m/s]	Width B [mm]														
		200	300	400	500	600	700	800	900	1000	1100	1200	1300	1400	1500	
Height H [mm]	200	4	13	16	19	20	21	22	23	24	25	26	27	29	30	30
		6	21	24	27	28	30	30	32	33	34	35	35	36	37	37
		8	30	33	35	37	38	39	41	43	44	45	46	47	49	49
		10	38	41	43	45	46	47	49	51	53	54	55	57	58	59
	300	4	17	20	23	24	26	27	28	29	29	30	31	32	33	33
		6	25	29	31	32	34	35	36	37	37	38	40	42	44	45
		8	34	37	39	41	42	43	44	45	46	47	48	49	49	50
		10	42	45	47	49	50	51	52	53	54	55	57	58	59	60
	400	4	20	23	25	27	28	29	30	31	32	32	33	34	35	35
		6	28	31	33	35	36	38	39	39	40	41	41	42	43	43
		8	36	40	42	43	45	46	47	47	48	49	49	50	51	52
		10	45	48	50	51	53	54	55	55	56	57	57	58	59	59
	500	4	22	25	27	29	30	31	32	33	34	34	35	36	37	38
		6	30	33	35	37	38	39	40	41	42	43	43	44	44	46
		8	37	41	44	45	46	48	48	49	50	51	51	52	51	53
		10	45	49	52	53	54	56	56	57	58	59	59	59	60	61
	600	4	23	26	28	30	31	33	33	34	35	36	36	37	39	39
		6	31	34	37	38	40	41	42	43	44	44	45	45	45	48
		8	40	43	45	47	48	49	50	51	51	52	53	53	53	55
		10	48	51	53	55	56	57	58	59	59	60	61	60	60	63
	700	4	-	28	30	31	33	34	35	36	36	37	38	38	40	40
		6	-	36	38	40	41	42	43	44	45	45	46	46	46	49
		8	-	44	46	48	49	50	51	52	53	53	54	54	54	56
		10	-	52	54	56	57	58	59	60	60	61	62	61	62	64
	800	4	-	29	31	32	34	35	36	37	37	38	39	39	41	41
		6	-	37	39	41	42	43	44	45	46	46	47	47	47	50
		8	-	45	47	49	50	51	52	53	54	54	55	55	55	57
		10	-	53	55	57	58	59	60	61	61	62	63	62	63	65
	900	4	-	29	31	33	34	36	37	37	38	39	40	40	42	42
		6	-	38	40	42	43	44	45	46	47	47	48	48	48	51
		8	-	46	48	50	51	52	53	54	54	55	56	56	56	58
		10	-	54	56	58	59	60	61	62	62	63	64	63	64	66
	1000	4	-	-	33	34	36	37	37	38	39	40	41	41	43	43
		6	-	-	41	42	44	45	46	47	47	48	49	49	49	52
		8	-	-	49	50	52	53	54	54	55	56	57	57	57	60
		10	-	-	57	58	60	61	62	62	63	64	65	65	66	67
	1100	4	-	-	33	35	37	38	38	39	40	41	42	42	-	-
		6	-	-	42	43	45	46	46	47	48	49	50	50	-	-
		8	-	-	50	51	53	54	54	55	56	57	58	58	-	-
		10	-	-	58	59	61	62	62	63	64	65	66	66	-	-
1200	4	-	-	34	36	38	39	39	40	41	42	43	-	-	-	
	6	-	-	43	44	46	47	47	48	49	50	51	-	-	-	
	8	-	-	51	52	54	55	55	56	57	58	59	-	-	-	
	10	-	-	59	60	62	63	63	64	65	66	67	-	-	-	

	1300	4	-	-	-	37	39	40	40	41	42	43	-	-	-	-
		6	-	-	-	44	46	47	47	48	49	50	-	-	-	-
		8	-	-	-	52	54	55	55	56	57	58	-	-	-	-
		10	-	-	-	60	62	63	63	64	65	66	-	-	-	-
	1400	4	-	-	-	37	39	40	40	41	42	-	-	-	-	-
		6	-	-	-	45	47	48	48	49	50	-	-	-	-	-
		8	-	-	-	54	56	57	57	58	59	-	-	-	-	-
		10	-	-	-	61	63	64	64	65	66	-	-	-	-	-
	1500	4	-	-	-	38	40	41	41	42	43	-	-	-	-	-
		6	-	-	-	46	48	49	49	50	51	-	-	-	-	-
		8	-	-	-	54	56	57	57	58	59	-	-	-	-	-
		10	-	-	-	62	64	65	65	66	67	-	-	-	-	-

v [m/s] - air flow velocity in the BxH connection duct

Table 4. Weight of KWP-P-E damper, m [kg].

KWP-P-E	Width B [mm]														
	200	300	400	500	600	700	800	900	1000	1100	1200	1300	1400	1500	
Height H [mm]	200	12,4	14,6	16,8	19,0	21,2	23,4	25,6	27,8	30,0	32,2	34,4	41,4	44,0	46,5
	300	14,4	17,0	19,7	22,2	24,9	27,5	30,1	32,7	35,4	38,0	40,6	48,3	51,2	54,2
	400	16,6	19,6	22,6	25,6	28,6	31,6	34,7	37,7	40,7	43,8	46,8	55,2	58,6	61,9
	500	18,7	22,1	25,6	29,0	32,4	35,8	39,3	42,7	46,1	49,5	52,9	62,2	65,9	69,6
	600	20,7	24,6	28,5	32,2	36,1	39,9	43,8	47,6	51,4	55,2	59,1	69,0	73,2	77,3
	700	-	27,1	31,4	35,5	39,8	44,0	48,3	52,5	56,7	61,0	65,2	75,9	80,4	85,0
	800	-	29,6	34,3	38,8	43,5	48,1	52,8	57,4	62,1	66,7	71,3	82,8	87,7	92,7
	900	-	32,1	37,1	42,1	47,2	52,2	57,3	62,3	67,4	72,4	77,5	89,6	96,2	101,5
	1000	-	-	40,1	45,5	51,0	56,4	61,9	67,4	72,8	78,2	83,7	97,8	103,6	109,3
	1100	-	-	43,2	48,9	54,8	60,7	66,5	72,4	78,2	84,1	90,2	104,6	-	-
	1200	-	-	46,2	52,3	58,7	64,9	71,1	77,5	83,7	90,0	104,5	-	-	-
	1300	-	-	-	61,6	68,6	75,6	82,6	89,6	97,8	104,4	-	-	-	-
	1400	-	-	-	65,3	72,8	80,1	87,5	96,2	103,6	-	-	-	-	-
	1500	-	-	-	69,0	76,9	84,7	92,5	101,5	109,3	-	-	-	-	-

Description of the product for projects

Product: smoke control damper type KWP-P, manufacturer: Smay

The smoke control damper type KWP-P is designed for installation in multi-zone or single-zone fire ventilation systems activated automatically and in mixed fire and general ventilation systems.

The smoke control damper type KWP-P has a fire resistance class from EI120(vedw i→o)S1000C10000AAmulti to EI120(vew how-i→o)S1500C10000AAmulti depending on the type and thickness of the building partition (smoke control duct) in which it is installed and the method of its installation. It can be installed in rigid ceilings (floors), rigid walls or single- and multi- zone smoke control ducts.

The smoke control damper type KWP-P is marked with the CE mark and is placed on the market based on the Certificate of Constancy of Performance No. 1488-CPR-0437/W, issued by the Building Research Institute for compliance with the harmonized standard PN-EN 12101-8. The declared fire resistance parameters of the damper are determined during fire tests performed according to the PN-EN 1366-2 and PN-EN 1366-10 standards. The smoke control damper type KWP-P installed in a battery (set) is marked with the B mark and is placed on the market based on the National Certificate of Constancy of Performance No. 020-UWB-2814/W, issued by the Building Research Institute for compliance with the National Technical Assessment No. ITB-KOT-2020/1398 edition 2.

The smoke control damper type KWP-P has a number of key features such as:

- possibility of installation in batteries (sets) of up to 16 dampers and a maximum surface area of up to 10 m²,
- possibility of making a damper up to 1500 mm high,
- rigid damper housing, equipped with an insulating spacer, facilitating assembly,
- possibility of making an inspection opening in the damper housing,
- possibility of any orientation of the damper rotation axis

KWP-P - Rectangular smoke control damper

When ordering, please provide information in accordance with the following pattern:

KWP-P-<F> - x <H> - <L> - <S> - <M> - <Q> - <P> - <RAL>

Where:

F	type of the actuation system used	
	E - electric actuator without a return spring	
B	damper clear width [mm]	
H	damper clear height [mm]	
L	damper length in mm, 350 by default (500 or 600 mm optionally)	
S	type of actuator used	
	BEN - for $B \times H \leq 1,21 \text{ m}^2$ and $H \leq 1100 \text{ mm}$	Product marking:
	BEE - for ($B \leq 1050$ and $1100 < H \leq 1200$) or ($1,21 \text{ m}^2 < B \times H \leq 1,30 \text{ m}^2$ and $H \leq 1200 \text{ mm}$)	24/230 – supply voltage
	BE - for $B \times H > 1,30 \text{ m}^2$ or $H > 1200 \text{ mm}$	ST – connection socket
M	installation in sets*	
	none - installation in sets not possible	
	M - damper adapted to installation in sets	
Q	inspection opening*	
	none - no inspection opening	
	R - inspection opening	
P	finishing*	
	none - galvanized steel	
	SL - coated steel	
RAL	colour as per RAL code (for SL finishing)*	

* optional items – if not indicated, default values will be used

Order example: **KWP-P-E-600x400-350-BEN24**